

MANOA FIRE COMPANY HAVERTOWN, PA

SO 145565 / Q108020


PUMPER TYPHOON 4X2 CHASSIS

1500 GPM HALE QMAX PUMP 780 GALLON WATER TANK		HOSE LOAD:			
		300' OF 1.75" DJ			
		200' OF 2.50" DJ			
		200' OF 1.75" DJ			
		1100' OF 5.00" LDH			
		600' OF 3.00" DJ			
		200' OF 1.75" DJ			
COMPT.	OPENING		INTERIOR DIMENSION		
L1	30W	68H	30W 30W	34H 30H	12D 26D
L2	56W	34H	56W	34H	12D
L3	45W	68H	45W 45W	34H 30H	12D 26D
R1	24W	30H	24W	30H	26D
R2	45W	30H	45W	30H	26D
B1	38W	28H	38W	28H	27D


THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.

(FOR INTERNAL SALES PURPOSES ONLY)


DEALER APPROVAL _____ DATE _____ AS IS
CUSTOMER APPROVAL _____ DATE _____ WITH REVISIONS

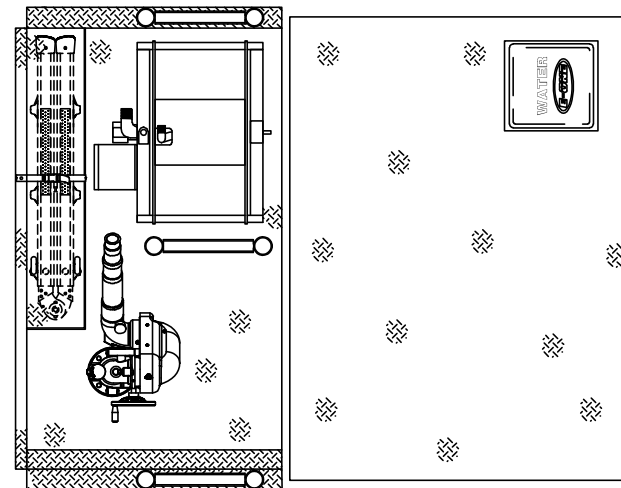


HOSEBED HEIGHT:
(FOR REFERENCE ONLY)
TO TAILBOARD: 39"
TO GROUND: 63±2"

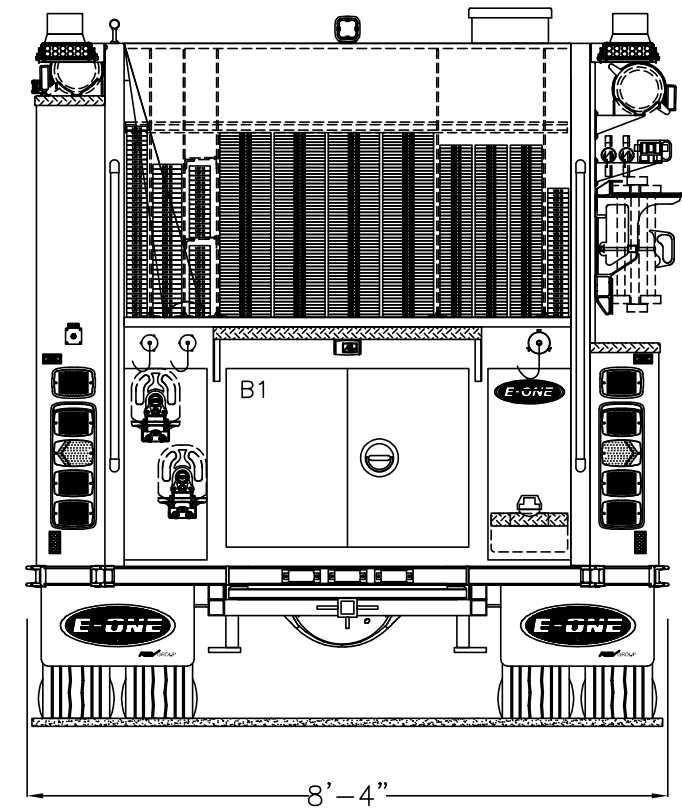

FIXED WALL MOUNTED TOOLBOARD
BEHIND VERTICAL HINGED HEAVY
DUTY SWING-OUT TOOLBOARD

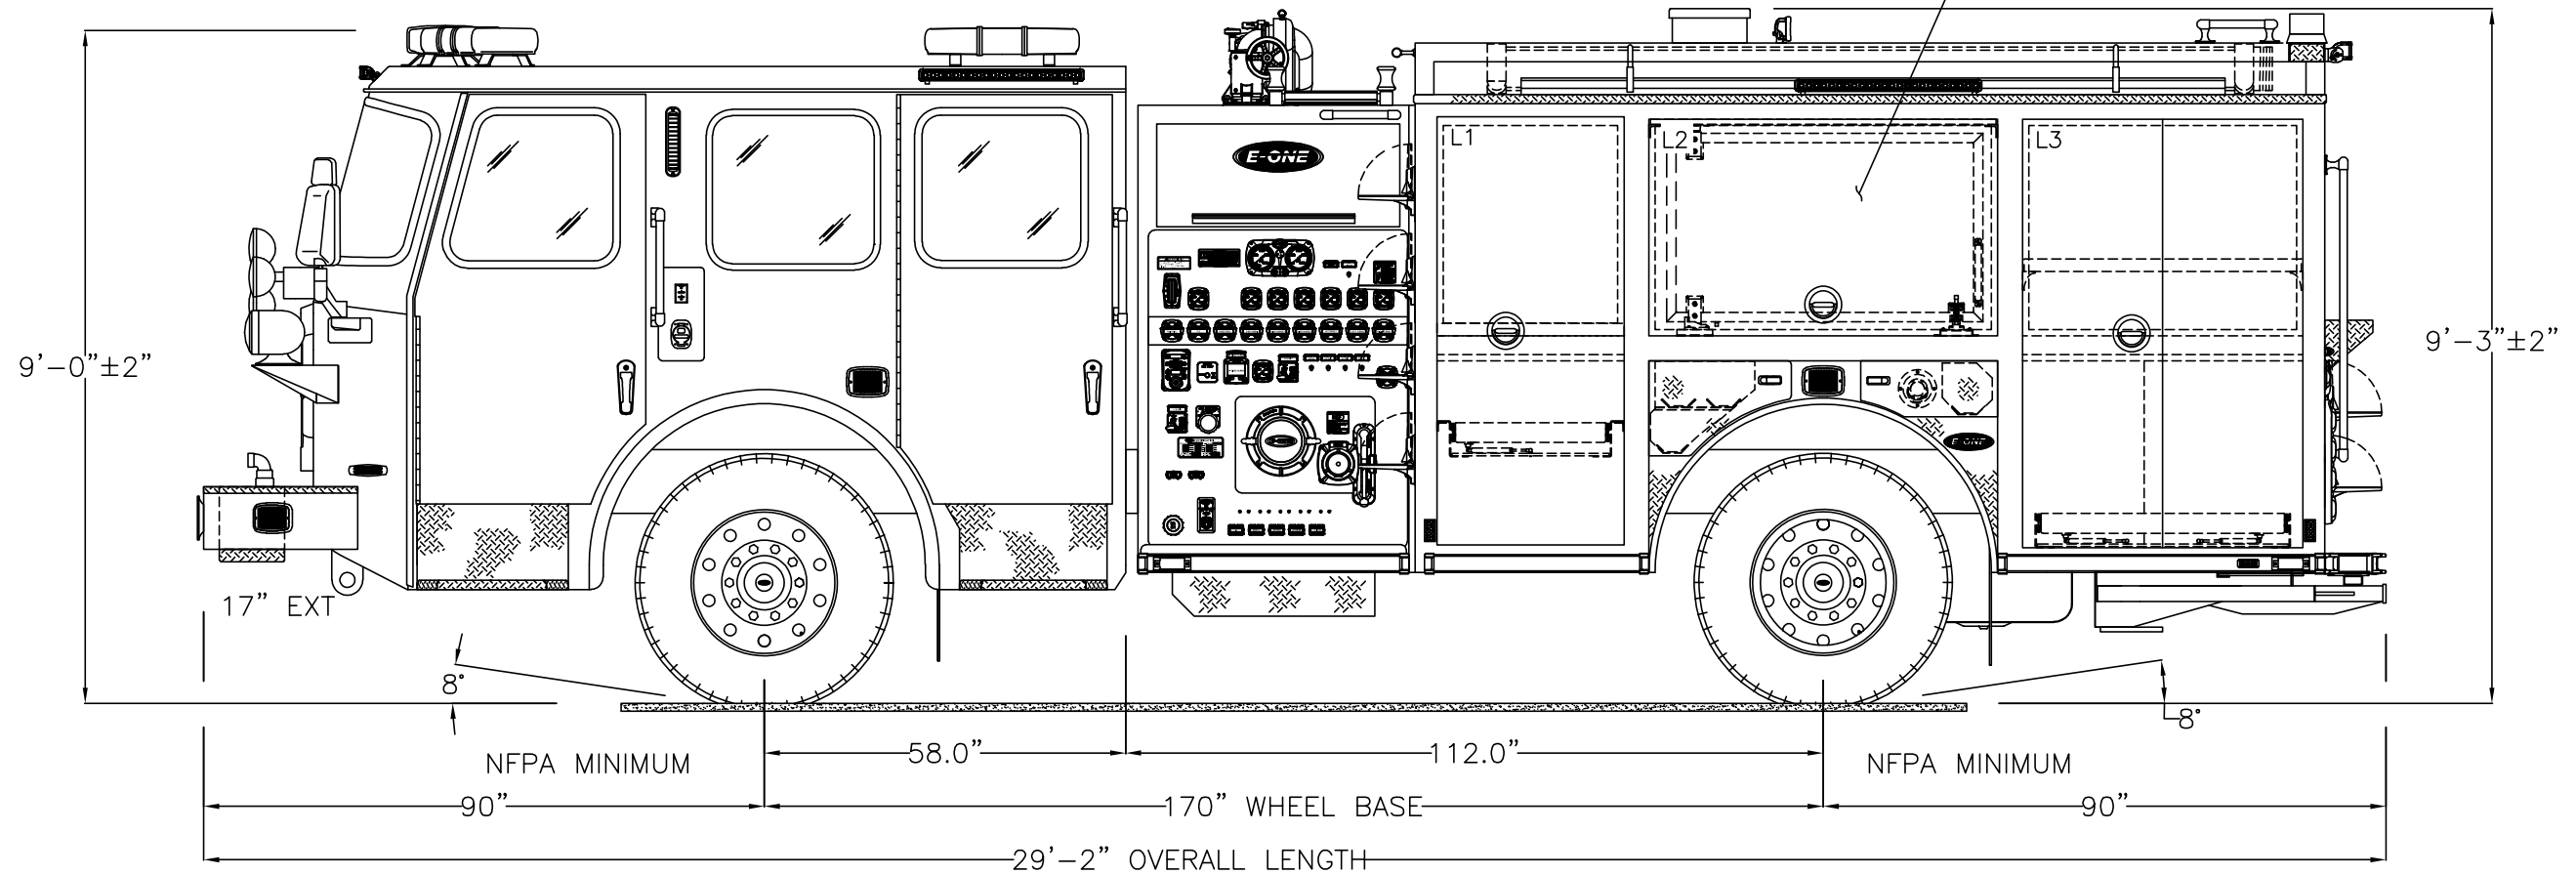

DROGMAN	B.2	CHANGE ORDER	2023-MAY-16	DROGMAN
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
APPROVAL REVISIONS		SHEET 1 OF 2		





MANOA FIRE COMPANY
HAVERTOWN, PA
SO 145565 / Q108020
PUMPER
TYPHOON 4X2 CHASSIS

THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE
 SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.

(FOR INTERNAL SALES PURPOSES ONLY)

DEALER APPROVAL _____ DATE _____ AS IS
 CUSTOMER APPROVAL _____ DATE _____ WITH REVISIONS

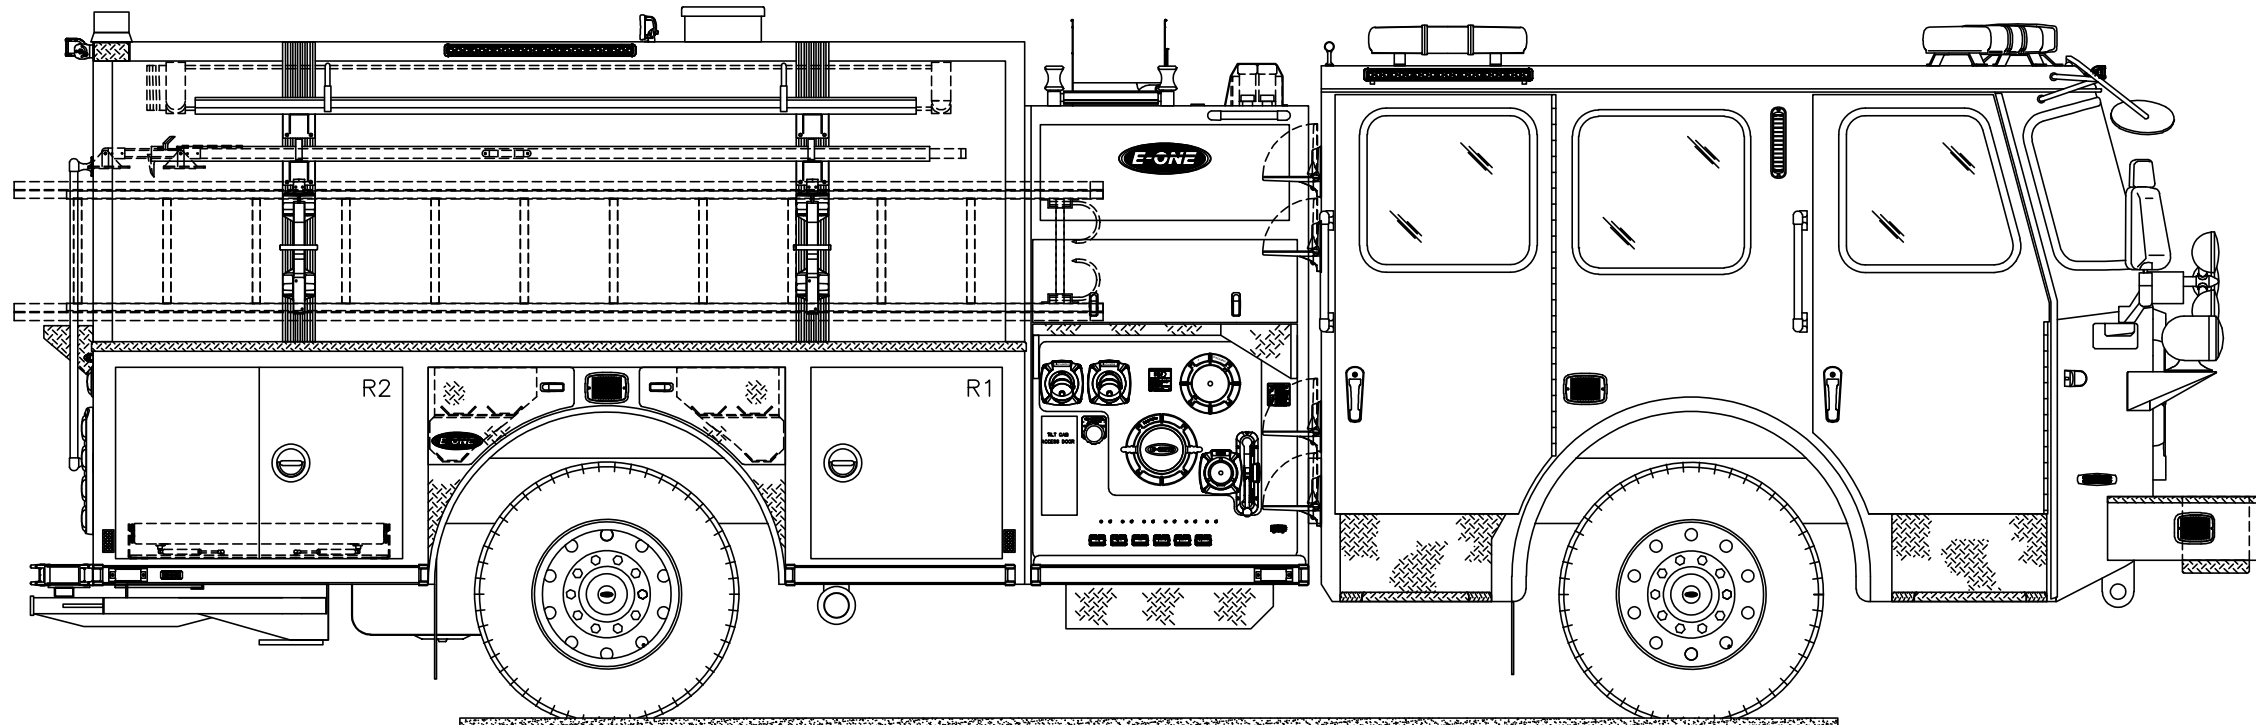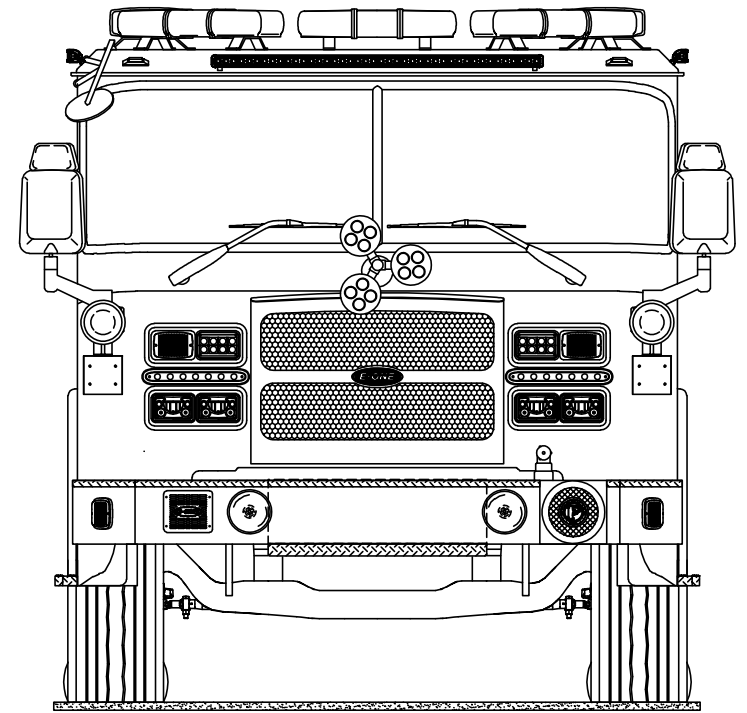

DRODMAN	B.2	CHANGE ORDER	2023-MAY-16	DRODMAN
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
		APPROVAL REVISIONS		SHEET 2 OF 2